




## Genotyping Report

Strain ID	T058647	Strain Type	CKO(Cas9)	Genetic Background	C57BL/6JGpt
Designer	Ya'nan Xu	Gene Name			<i>Kcnab2</i>

### 1. Strategy of Genotyping

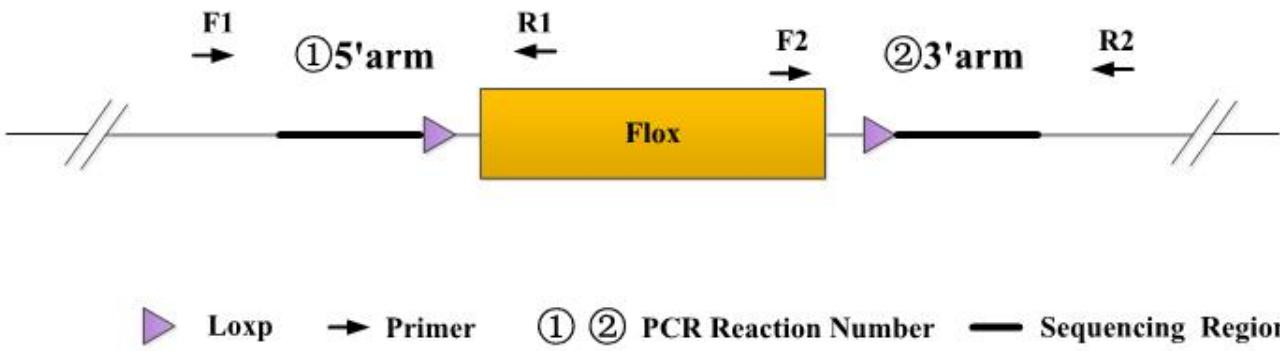

Wild type: ①PCR reaction obtains a single WT band; ②PCR reaction obtains a single WT band.

Heterozygote: ①PCR reaction obtains a WT band and a Targeted band; ②PCR reaction obtains a WT band and a Targeted band.


Homozygote: ①PCR reaction obtains a single Targeted band; ②PCR reaction obtains a single Targeted band.


Note: The sizes of WT and Targeted band are shown below.

### 2. Primer Information

PCR No.	Primer No.	Sequence	Band Size
①(5'arm)	T058647(P1)-F1	GCATGTACGCACAAAGAACAGG	WT: 340bp
	T058647(P1)-R1	TTGGAACGCTAGGCTGCCTAT	Targeted: 445bp
②(3'arm)	T058647(P1)-F2	AGGGCTTCTGGAAATATCGGAT	WT: 379bp
	T058647(P1)-R2	GTACCCTGTCCATTCCAGAAGATG	Targeted: 485bp

### 3. Gel Image & Conclusion



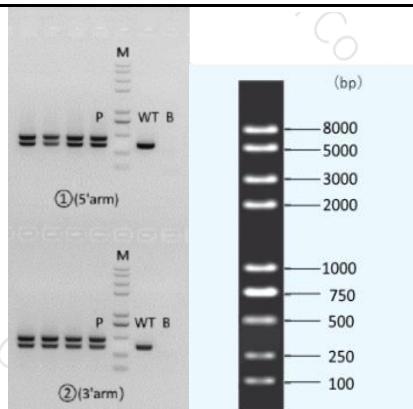

Note: P: Heterozygous samples; WT: Wildtype control; B: Blank control ( $\text{ddH}_2\text{O}$ ); M: DNA Ladder

① Control (WT) : It is an important reference mark for whether the PCR reaction is successful and whether the product band position and size meet the theoretical requirements.

② Control (B) : PCR amplification was performed without template in the PCR reagent to monitor whether the reagent was contaminated.

#### 4. PCR Condition

PCR Reaction Component			
Seg.	reaction component	Volume ( $\mu\text{l}$ )	
1	2 × Rapid Taq Master Mix (Vazyme P222)	12.5	
2	$\text{ddH}_2\text{O}$	9.5	
3	Primer A(10pmol/ $\mu\text{l}$ )	1	
4	Primer B(10pmol/ $\mu\text{l}$ )	1	
5	Template(20~80ng/ $\mu\text{l}$ )	1	

#### PCR program I priority selection

Seg.	Temp.	Time	Cycle
1	95 °C	5min	
2	98 °C	30s	
3	65 °C * (-0.5 °C/cycle)	30s	
4	72 °C	45s*	
5	98 °C	30s	
6	55 °C *	30s	
7	72 °C	45s*	
8	72 °C	5min	
9	10 °C	hold	

#### PCR program II the second choice

Seg.	Temp.	Time	Cycle
1	95 °C	5min	



江苏集萃药康生物科技股份有限公司  
GemPharmatech Co.,Ltd

2	98°C	30s	35x
3	58°C*	30s	
4	72°C	45s*	
5	72°C	5min	
6	10°C	hold	

Note\*: Annealing temperature and extension time can be determined according to the actual amplification situation and amplification enzyme efficiency.