


Genotyping Report

| | | | | | |
|-----------|--------------|-------------|--------------|--------------------|-------------|
| Strain ID | T032136 | Strain Type | KO(Cas9) | Genetic Background | C57BL/6JGpt |
| Designer | Tiantian Sun | Gene Name | <i>Clic3</i> | | |

1. Strategy of Genotyping

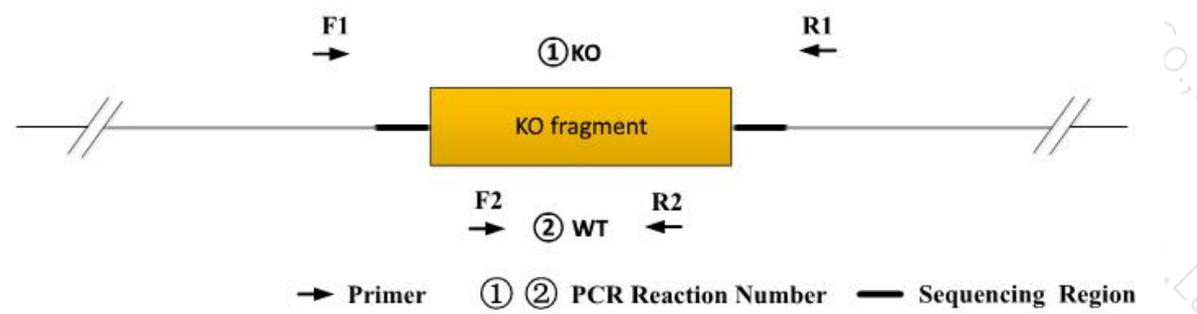


Wild type: ①PCR reaction obtains a single WT band; ②PCR reaction obtains a single WT band.
 Heterozygote: ①PCR reaction obtains a WT band and a KO band; ②PCR reaction obtains a WT band.
 Homozygote: ①PCR reaction obtains a single KO band; ② PCR reaction without product.

Note: 1)The sizes of WT and Targeted band are shown below.
 2) If the WT band is too large, it may not be possible to obtain a WT band.

2. Primer Information

| PCR No. | Primer No. | Primer Name | Sequence | Band Size |
|---------|------------|----------------|--------------------------|-------------------------|
| PCR① | F1 | T032136(P1)-F1 | GGCACCTGGCATTAGTAGAGATTC | WT: 2108bp KO: 641bp |
| | R1 | T032136(P1)-R1 | AAGCTGAGAGCGTCCTGGTCT | |
| PCR② | F2 | T032136(P1)-F2 | TTCACACCTATAGCTTCCTAGCC | WT: 297bp KO: 0bp |
| | R2 | T032136(P1)-R2 | ACGAAGATGTGGCTCCTGTGC | |

3. Gel Image

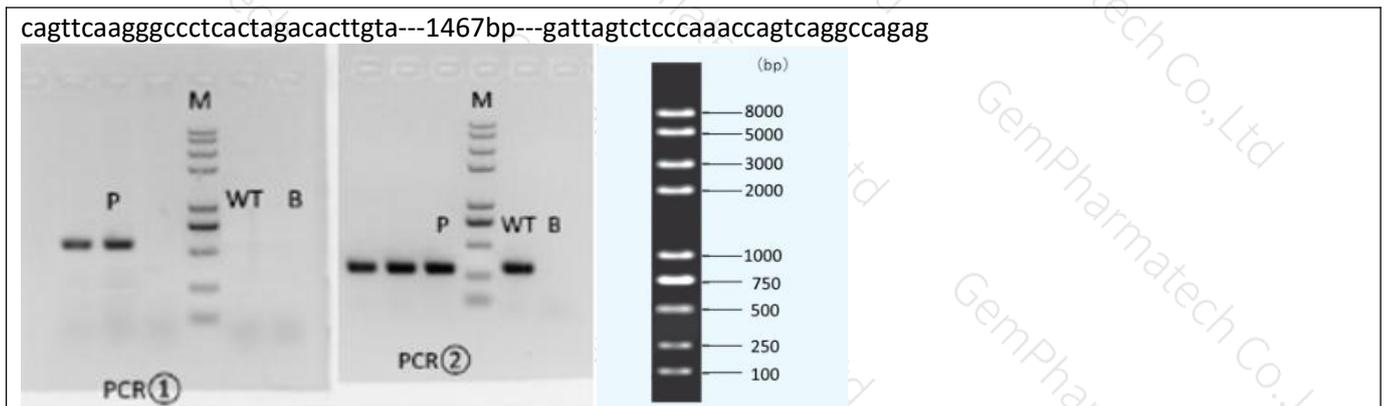

Note: P: Heterozygous samples; WT: Wildtype control; B: Blank control (ddH₂O); M: DNA Ladder
 ① Control (WT) : It is an important reference mark for whether the PCR reaction is successful and whether the product band position and size meet the theoretical requirements.
 ② Control (B) : PCR amplification was performed without template in the PCR reagent to monitor whether the reagent was contaminated.

4. PCR Condition

| PCR Reaction Component | | | |
|------------------------------------|--|------|-------------|
| Seg. | reaction component | | Volume (μl) |
| 1 | 2 × Rapid Taq Master Mix (Vazyme P222) | | 12.5 |
| 2 | ddH ₂ O | | 9.5 |
| 3 | Primer A(10pmol/μl) | | 1 |
| 4 | Primer B(10pmol/μl) | | 1 |
| 5 | Template(20~80ng/μl) | | 1 |
| PCR program I (priority selection) | | | |
| Seg. | Temp. | Time | Cycle |
| 1 | 95℃ | 5min | |
| 2 | 98℃ | 30s | 20× |
| 3 | 65℃* (-0.5℃/cycle) | 30s | |
| 4 | 72℃ | 45s* | |
| 5 | 98℃ | 30s | |
| 6 | 55℃* | 30s | 15× |
| 7 | 72℃ | 45s* | |
| 8 | 72℃ | 5min | |
| 9 | 10℃ | hold | |
| PCR program II (the second choice) | | | |
| Seg. | Temp. | Time | Cycle |
| 1 | 95℃ | 5min | |
| 2 | 98℃ | 30s | 35× |
| 3 | 58℃* | 30s | |
| 4 | 72℃ | 45s* | |
| 5 | 72℃ | 5min | |
| 6 | 10℃ | hold | |

Note*: Annealing temperature and extension time can be determined according to the actual amplification situation and amplification enzyme efficiency.