

## Genotyping Report

|           |              |             |                |                    |             |
|-----------|--------------|-------------|----------------|--------------------|-------------|
| Strain ID | T065254      | Strain Type | KO(Cas9)       | Genetic Background | C57BL/6JGpt |
| Designer  | Tiantian Sun | Gene Name   | <i>Ppp1r3g</i> |                    |             |

### 1. Strategy of Genotyping




Wild type: ①PCR reaction obtains a single WT band; ②PCR reaction obtains a single WT band.  
Heterozygote: ①PCR reaction obtains a WT band and a KO band; ②PCR reaction obtains a WT band.  
Homozygote: ①PCR reaction obtains a single KO band; ② PCR reaction without product.  
Note: 1)The sizes of WT and Targeted band are shown below.  
2) If the WT band is too large, it may not be possible to obtain a WT band.

### 2. Primer Information

| PCR No.         | Primer No. | Primer Name    | Sequence               | Band Size              |
|-----------------|------------|----------------|------------------------|------------------------|
| PCR①            | F1         | T065254(P1)-F1 | CGCTCGATTGCTTGCCTTAATG | WT:2183bp<br>KO: 945bp |
|                 | R1         | T065254(P1)-R1 | TTGTCACACTGCCGTGTCATCA |                        |
| PCR②<br>GC: 67% | F2         | T065254(P1)-F2 | TACAGGAATATCGCCGCTCTCG | WT:266bp<br>KO:0bp     |
|                 | R2         | T065254(P1)-R2 | GAAGCTGTGGAGACGGGAAAGT |                        |

### 3. Gel Image

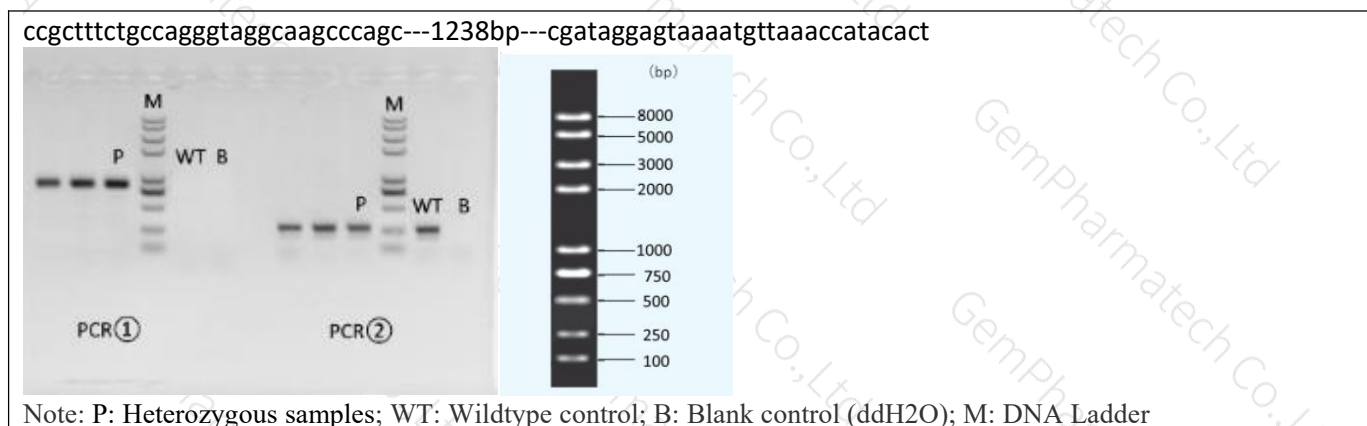

- ① Control (WT) : It is an important reference mark for whether the PCR reaction is successful and whether the product band position and size meet the theoretical requirements.
- ② Control (B) : PCR amplification was performed without template in the PCR reagent to monitor whether the reagent was contaminated.

#### 4. PCR Condition

(Generally recommend to use Vazyme P222; If the sequences contain special structures such as GC%  $\geq$  60% or GC%  $\leq$  40%, recommend to use Vazyme P515.)

| PCR Reaction Component             |                                                                                        |      |             |
|------------------------------------|----------------------------------------------------------------------------------------|------|-------------|
| Seg.                               | reaction component                                                                     |      | Volume (μl) |
| 1                                  | 2 × Rapid Taq Master Mix(Vazyme P222)<br>or<br>2 × Phanta Max Master Mix (Vazyme P515) |      | 12.5        |
| 2                                  | ddH2O                                                                                  |      | 9.5         |
| 3                                  | Primer A(10pmol/μl)                                                                    |      | 1           |
| 4                                  | Primer B(10pmol/μl)                                                                    |      | 1           |
| 5                                  | Template(20~80ng/μl)                                                                   |      | 1           |
| PCR program I (priority selection) |                                                                                        |      |             |
| Seg.                               | Temp.                                                                                  | Time | Cycle       |
| 1                                  | 95℃                                                                                    | 5min | 20×         |
| 2                                  | 98℃                                                                                    | 30s  |             |
| 3                                  | 65℃* (-0.5℃/cycle)                                                                     | 30s  |             |
| 4                                  | 72℃                                                                                    | 45s* |             |
| 5                                  | 98℃                                                                                    | 30s  | 15×         |
| 6                                  | 55℃*                                                                                   | 30s  |             |
| 7                                  | 72℃                                                                                    | 45s* |             |
| 8                                  | 72℃                                                                                    | 5min |             |
| 9                                  | 10℃                                                                                    | hold |             |
| PCR program II (the second choice) |                                                                                        |      |             |
| Seg.                               | Temp.                                                                                  | Time | Cycle       |
| 1                                  | 95℃                                                                                    | 5min | 35×         |
| 2                                  | 98℃                                                                                    | 30s  |             |
| 3                                  | 58℃*                                                                                   | 30s  |             |
| 4                                  | 72℃                                                                                    | 45s* |             |
| 5                                  | 72℃                                                                                    | 5min |             |
| 6                                  | 10℃                                                                                    | hold |             |

Note\*: Annealing temperature and extension time can be determined according to the actual amplification situation and amplification enzyme efficiency.